
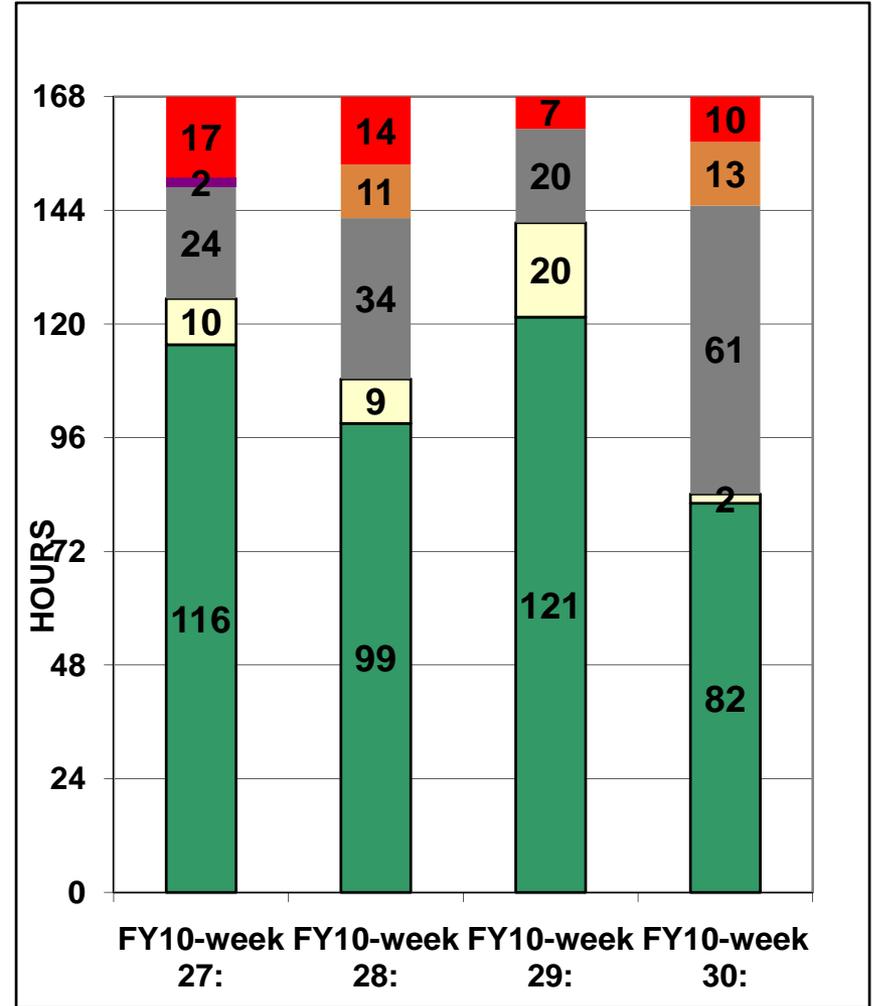


March & April

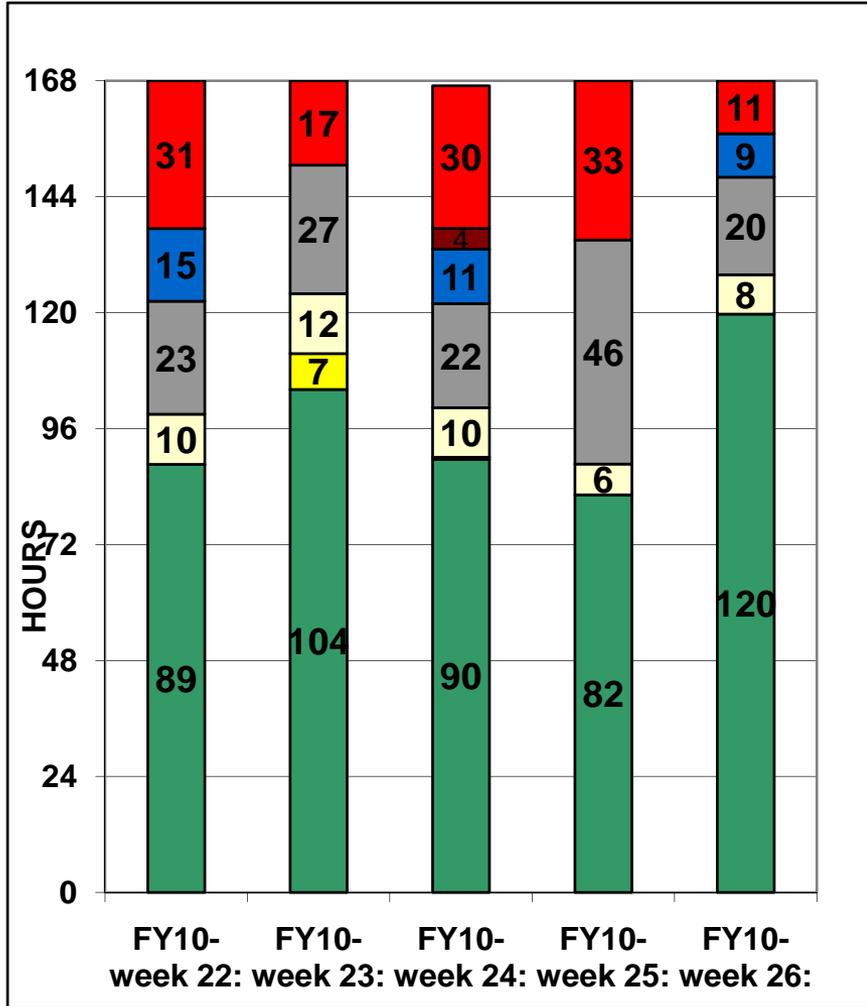


INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM --APRIL 2010

PowerSupply RHIC
Yi6-qd2 trips QLI 2x

Vacuum RHIC
Gauge Controller PS

Services AtR
Air line coupling – Vacuum
valves closed

03/30/10/1 to 04/06/10/1
04/06/10/2 to 04/13/10/1
04/13/10/2 to 04/20/10/1
04/20/10/2 to 04/27/10/1

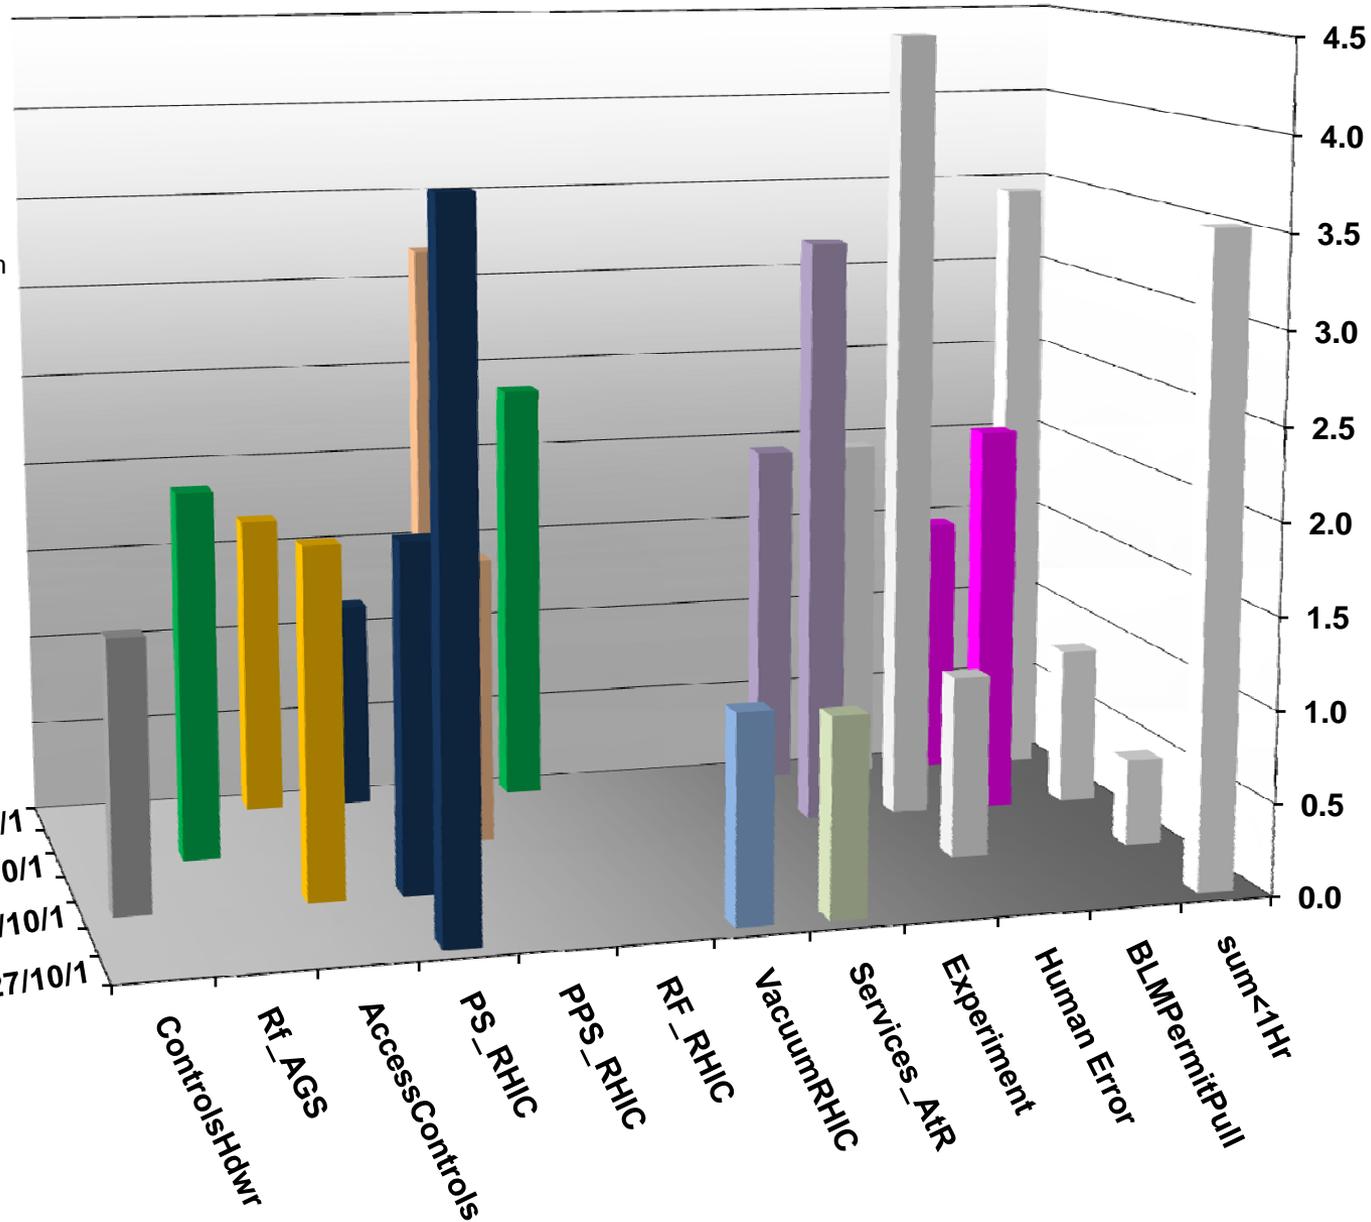

Run10 availability (81.1%)

