
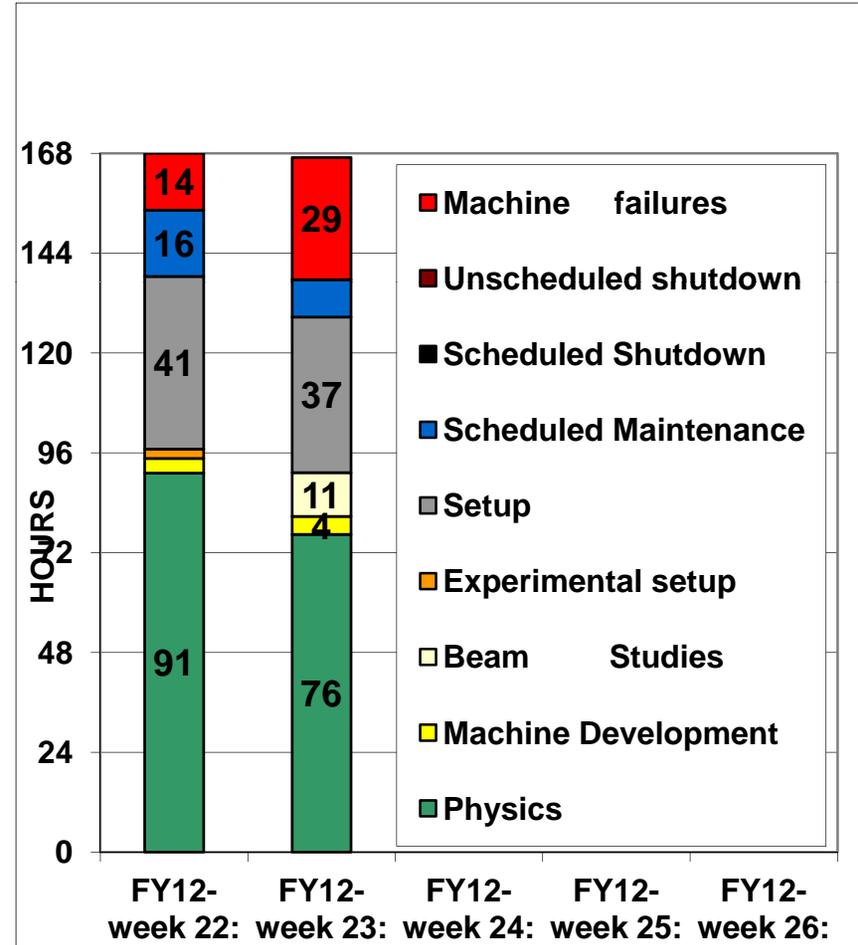


# Availability February-March Run12

last week (23) availability 81% v 91% for week 22

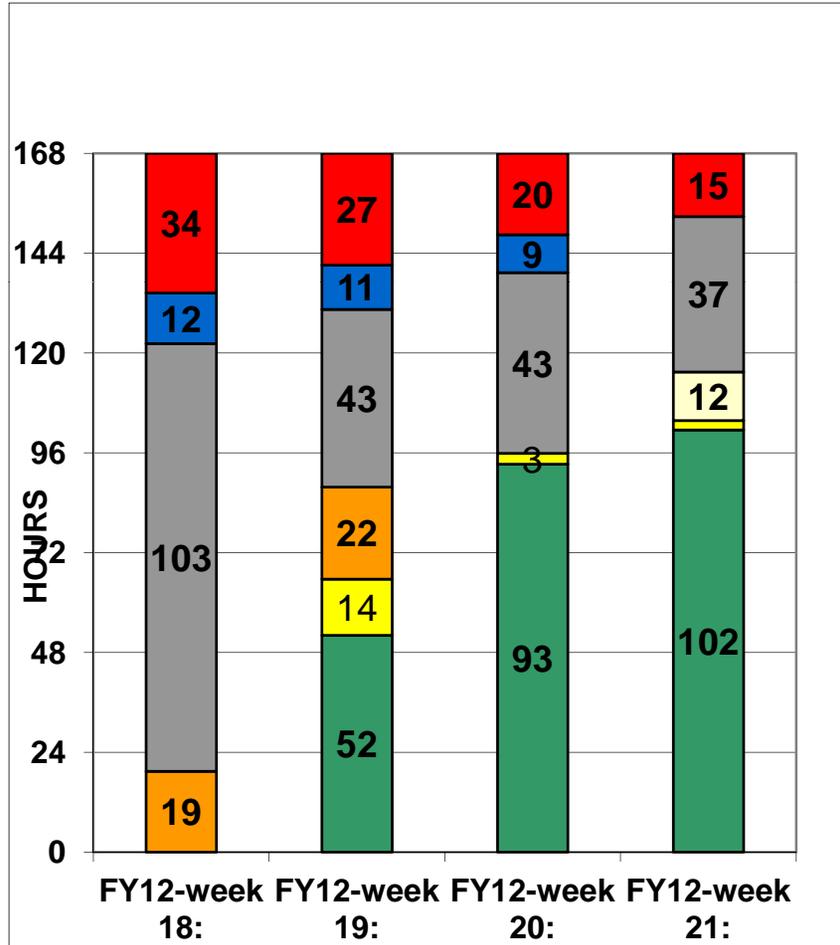

# INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM MARCH 2011

## PS\_RHIC

Bi9-snk7-1.4ps

Bi9-q89ps - replaced

## AGC\_RHIC

7:00 ODH current loop (2x)

Critical Device for Rf turns off 6 cavities

## QuenchProtection

Bo6-qd3 qpa swapped out

## Experiments

P – W carriage comm w/ HV

S – ps recovery from power dip 3/6

S – ps trips during store – Phenix turns off

## Cooling Water Booster

Backflush BtA DH2

