Availability March-April Run12

last week availability 86%

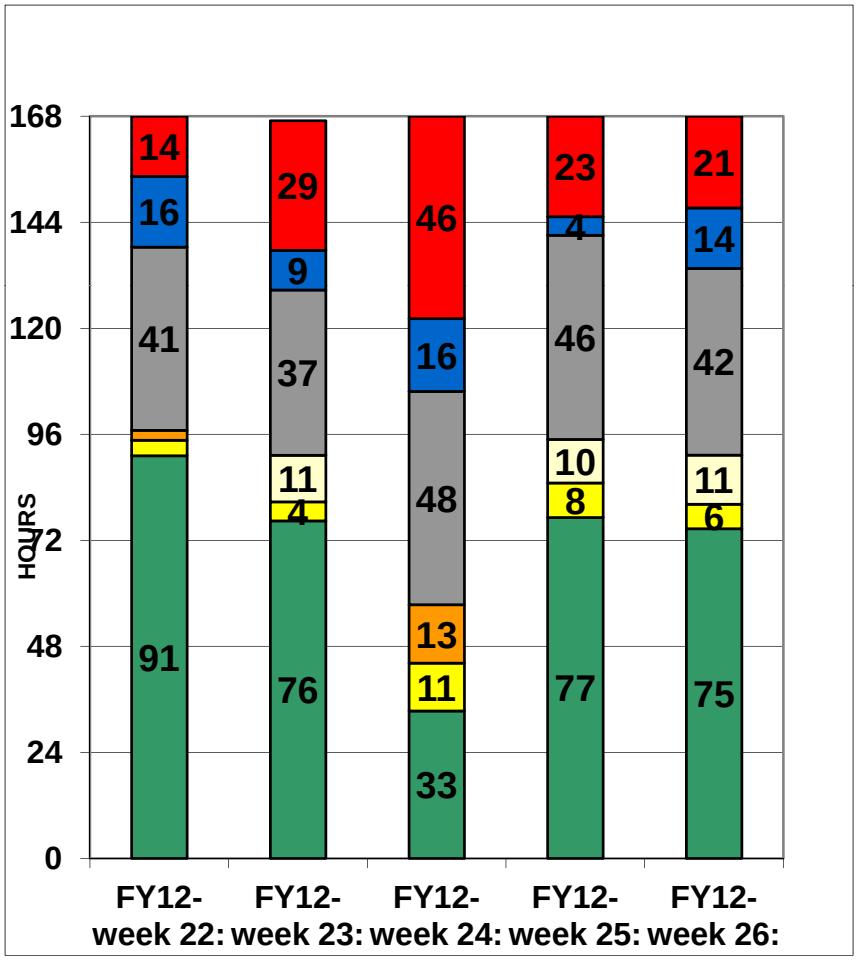

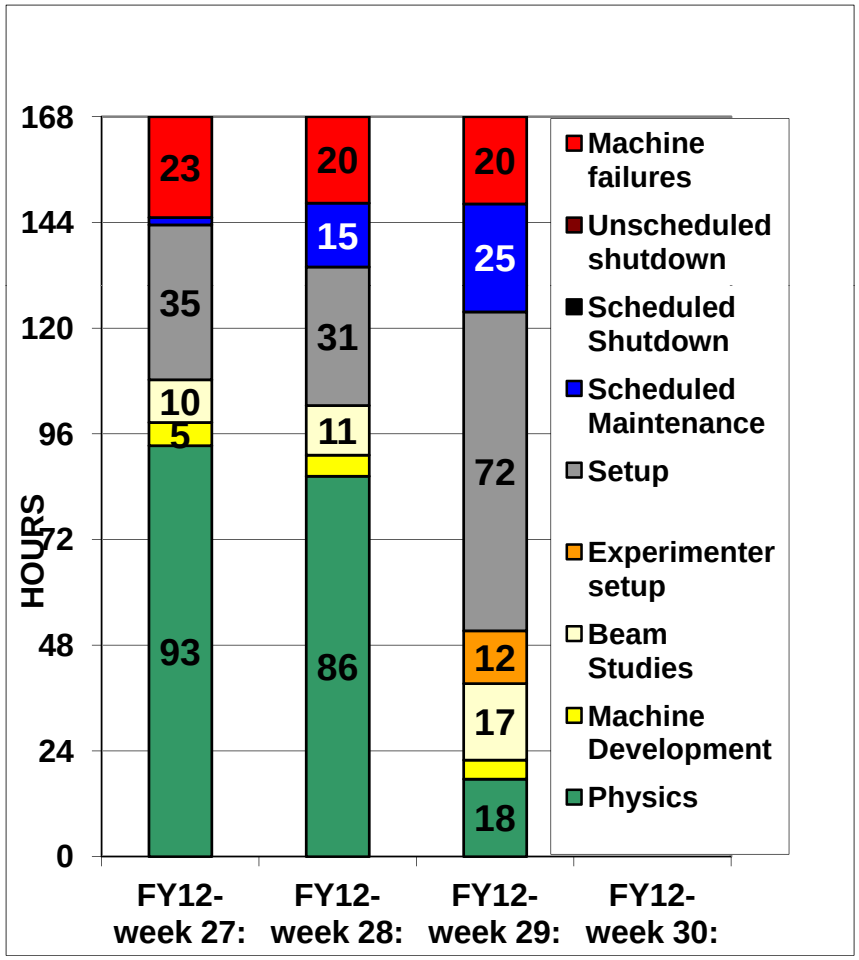

INTEGRATED FAILURES (GREATER THAN ONE HOUR) BY SYSTEM --April 2012
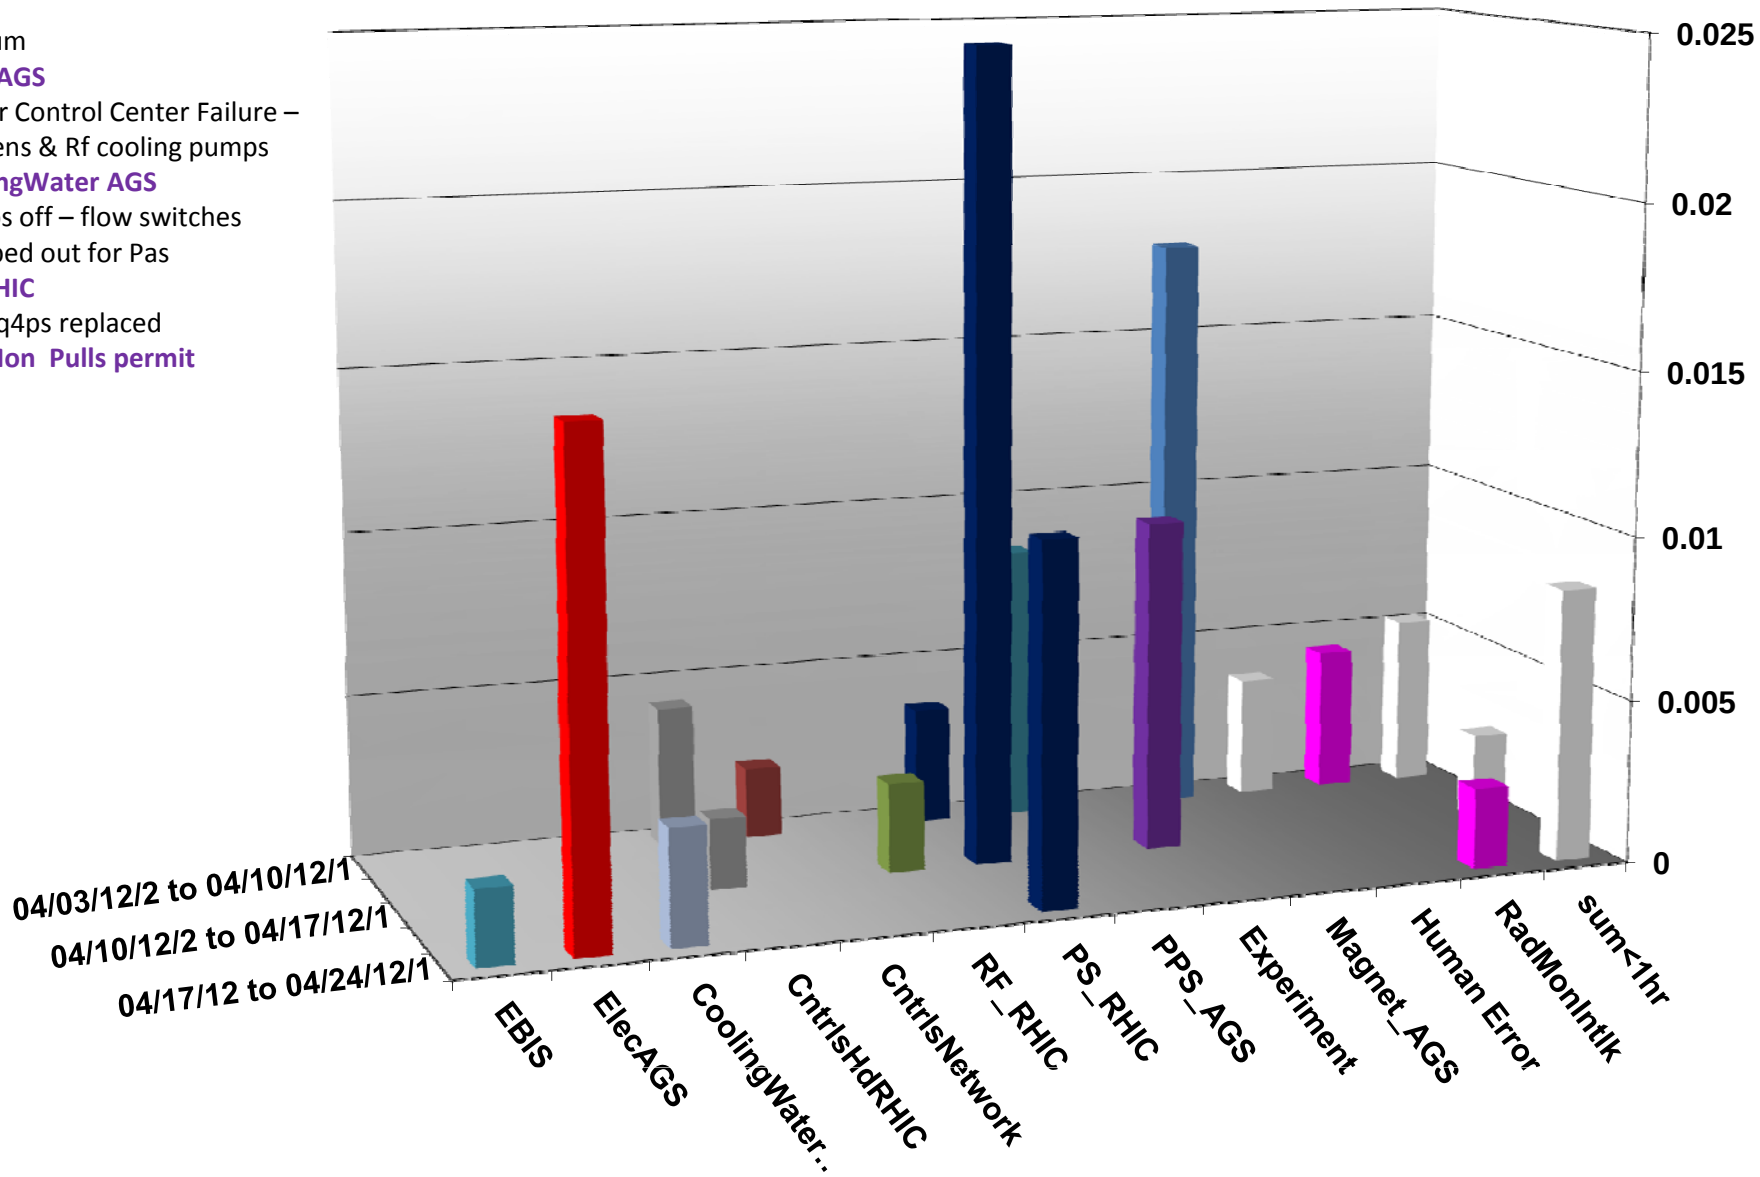
EBIS
Vaccum
Elec_AGS
Motor Control Center Failure – Siemens & Rf cooling pumps
CoolingWater AGS
Pumps off – flow switches dropped out for Pas
PS_RHIC
Y08-tq4ps replaced
RadMon Pulls permit
5x